

KUPU-R43B-1000-4000K-C20UP15D



Light Output Ratio:	100.0%	
Luminaire Power:	24.1 W	
SHR Nominal:	0.00	Calculated using the TM5
SHR Maximum:	0.30	fine grid method.

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: 邓光文
Test Date: 2026-08-29


γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity: 65.0%
Test Distance: 8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm		
NAME: LED洗墙灯	TYPE: /	WEIGHT: /
SPEC.: 1000*43*91MM	DIM.: /	SERIAL No.: /
MFR.: GZAILITELED	SUR.: 0.072	Shielding Angle: /

DATA OF LAMP		PHOTOMETRIC DATA Eff: 77.74 lm/W			
MODEL	R28B	I _{max} (cd)	10581	S/MH(C0/180)	0.33
NOMINAL POWER(W)	24	LOR(%)	100.0	S/MH(C90/270)	0.16
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	1873.6	η UP,DN(C0-180)	0.4,69.7
NOMINAL FLUX(lm)	1873.63	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.5,29.4
LAMPS INSIDE	1	η up(%)	1.0	CIBSE SHR NOM	0.00
TEST VOLTAGE(V)	220	η down(%)	99.0	CIBSE SHR MAX	0.30

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

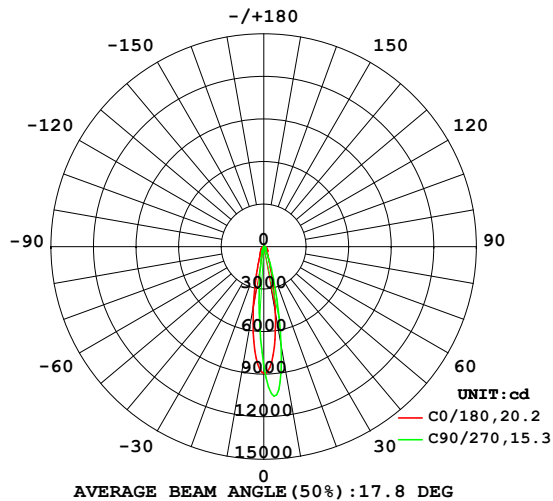

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

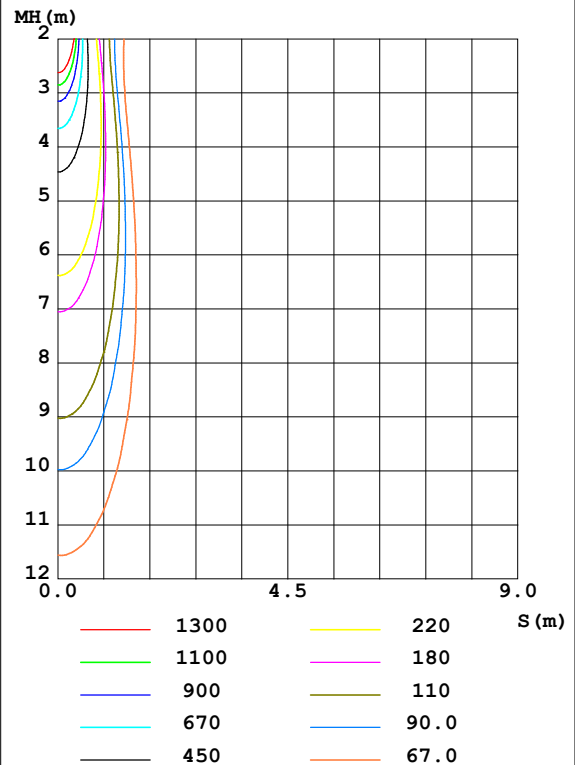

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: 邓光文
Test Date: 2026-08-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity: 65.0%
Test Distance: 8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:


γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	475.5	643.5	709.7	737.0	428.7	189.6	141.9	184.0	0- 10	598.4	598.4	31.9,31.9
20	116.3	170.9	141.2	183.8	101.6	45.78	35.66	43.66	10- 20	608.9	1207	64.4,64.4
30	51.44	55.07	33.86	60.91	49.00	18.80	4.687	17.35	20- 30	279.7	1487	79.4,79.4
40	34.67	22.21	14.82	25.24	33.13	4.266	0.9148	2.810	30- 40	155.8	1643	87.7,87.7
50	22.70	10.04	7.650	10.92	21.50	0.7104	0.1520	0.3931	40- 50	98.97	1742	93,93
60	12.93	4.842	3.835	5.008	12.01	0.0934	0.0302	0.0847	50- 60	60.46	1802	96.2,96.2
70	5.822	2.496	1.888	2.486	5.325	0.0274	0.0282	0.0279	60- 70	34.31	1837	98,98
80	1.878	0.9178	0.9057	0.8744	1.577	0.0260	0.0196	0.0254	70- 80	15.53	1852	98.9,98.9
90	0.0204	0.1737	0.2856	0.1642	0.0185	0.0168	0.0112	0.0196	80- 90	3.666	1856	99,99
100	0.0397	0.0634	0.1795	0.0637	0.0433	0.0238	0.0196	0.0313	90-100	0.7690	1857	99.1,99.1
110	0.0732	0.0293	0.0694	0.0224	0.0799	0.0439	0.0355	0.0620	100-110	0.5644	1857	99.1,99.1
120	0.1266	0.0431	0.0238	0.0224	0.1356	0.0872	0.0598	0.1238	110-120	0.6139	1858	99.2,99.2
130	0.2324	0.0906	0.0290	0.0481	0.2564	0.1883	0.1306	0.2598	120-130	0.9777	1859	99.2,99.2
140	0.4831	0.2383	0.0874	0.1253	0.5204	0.4750	0.3984	0.5958	130-140	1.867	1861	99.3,99.3
150	0.8418	0.6412	0.3256	0.4019	0.8771	1.001	1.066	1.033	140-150	3.445	1864	99.5,99.5
160	1.172	1.141	0.9766	0.9294	1.210	1.347	1.473	1.292	150-160	4.543	1869	99.7,99.7
170	1.405	1.477	1.441	1.273	1.435	1.319	1.431	1.286	160-170	3.683	1872	99.9,99.9
180	1.535	1.493	1.425	1.291	1.536	1.493	1.426	1.290	170-180	1.342	1874	100,100
DEG	LUMINOUS INTENSITY:×10cd									UNIT:lm		

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:邓光文
 Test Date:2026-08-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.443
 Humidity:65.0%
 Test Distance:8.440m [K=1.0000]
 Remarks: 广州市花都区花城街永昌路21号
 联系电话: 020-06933476

LUMINANCE LIMITATION CURVES

Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm		
NAME: LED洗墙灯	TYPE: /	WEIGHT: /
SPEC.: 1000*43*91MM	DIM.: /	SERIAL No.: /
MFR.: GZAILITELED	SUR.: 0.072	Shielding Angle: /

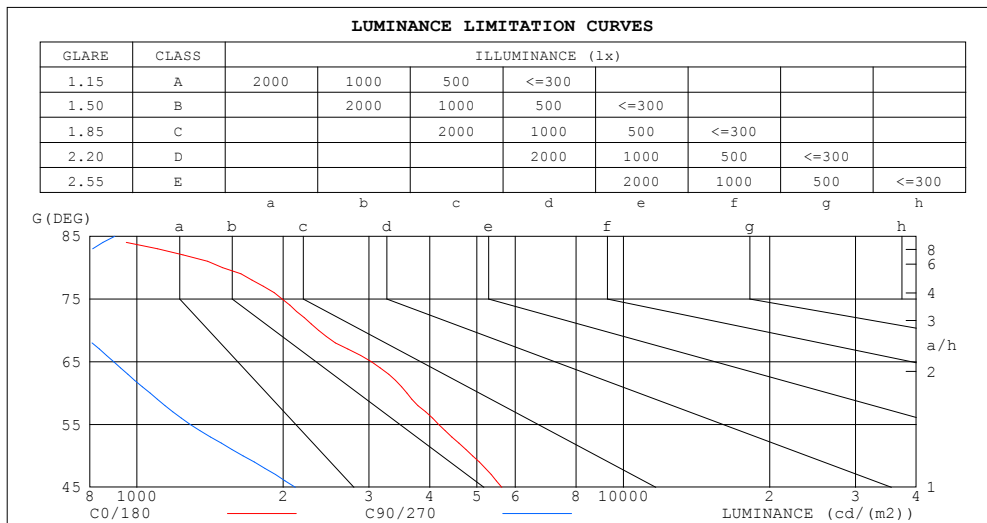

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	782	901
80	1502	724
75	1990	678
70	2364	767
65	3039	897
60	3592	1065
55	4176	1288
50	4905	1653
45	5625	2119


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: 邓光文
Test Date: 2026-08-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity: 65.0%
Test Distance: 8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm		
NAME: LED洗墙灯	TYPE: /	WEIGHT: /
SPEC.: 1000*43*91MM	DIM.: /	SERIAL No.: /
MFR.: GZAILITELED	SUR.: 0.072	Shielding Angle: /

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.01	1.01	1.01	.99
1.0	1.11	1.09	1.07	1.09	1.07	1.05	1.05	1.03	1.02	1.01	.99	.98	.97	.96	.95	.94
2.0	1.04	1.01	.98	1.03	.99	.97	.99	.97	.94	.96	.94	.92	.93	.92	.90	.89
3.0	.99	.94	.91	.97	.93	.90	.95	.91	.88	.92	.89	.87	.90	.87	.85	.84
4.0	.94	.89	.85	.92	.88	.85	.90	.86	.83	.88	.85	.82	.86	.84	.81	.80
5.0	.89	.84	.80	.88	.84	.80	.86	.82	.79	.85	.81	.79	.83	.80	.78	.76
6.0	.85	.80	.77	.85	.80	.76	.83	.79	.76	.82	.78	.75	.80	.77	.75	.73
7.0	.82	.77	.73	.81	.76	.73	.80	.76	.73	.79	.75	.72	.78	.74	.72	.71
8.0	.79	.74	.70	.78	.74	.70	.77	.73	.70	.76	.72	.70	.75	.72	.69	.68
9.0	.76	.71	.68	.75	.71	.68	.75	.70	.67	.74	.70	.67	.73	.69	.67	.66
10.0	.73	.69	.66	.73	.69	.65	.72	.68	.65	.71	.68	.65	.71	.67	.65	.64

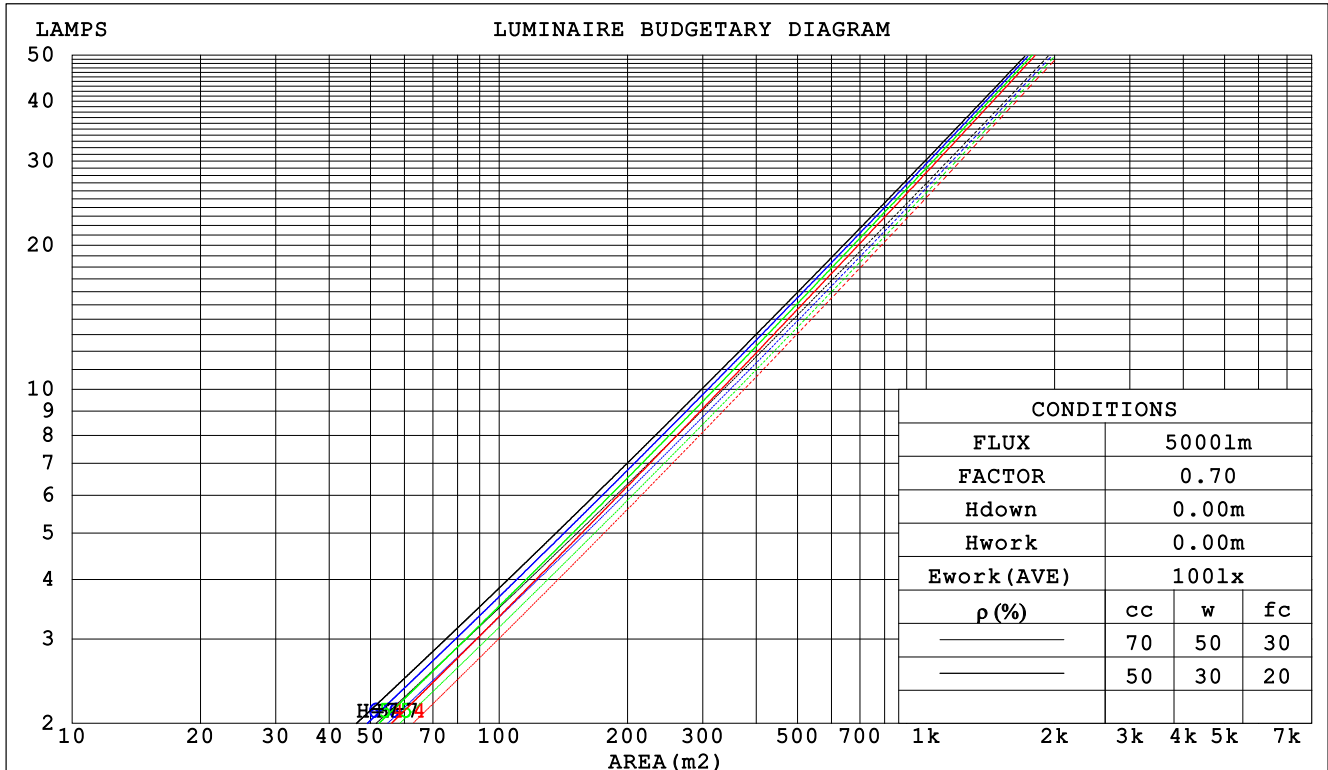

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:邓光文
Test Date:2026-08-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity:65.0%
Test Distance:8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

WEC AND CCEC

Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm		
NAME: LED洗墙灯	TYPE: /	WEIGHT: /
SPEC.: 1000*43*91MM	DIM.: /	SERIAL No.: /
MFR.: GZAILITELED	SUR.: 0.072	Shielding Angle: /

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)										
0.0																	
1.0	.165	.094	.030	.158	.090	.029	.145	.083	.027	.133	.077	.025	.122	.071	.023		
2.0	.155	.085	.026	.149	.082	.025	.138	.077	.024	.128	.072	.022	.119	.067	.021		
3.0	.145	.077	.023	.140	.075	.023	.131	.071	.022	.122	.067	.021	.114	.063	.020		
4.0	.136	.071	.021	.131	.069	.020	.123	.065	.020	.116	.062	.019	.109	.059	.018		
5.0	.127	.065	.019	.124	.064	.019	.117	.061	.018	.110	.058	.017	.104	.056	.017		
6.0	.120	.060	.017	.117	.059	.017	.111	.057	.017	.105	.055	.016	.100	.053	.016		
7.0	.113	.056	.016	.111	.055	.016	.105	.053	.015	.100	.051	.015	.096	.050	.015		
8.0	.107	.053	.015	.105	.052	.015	.100	.050	.014	.096	.049	.014	.092	.047	.014		
9.0	.102	.049	.014	.100	.049	.014	.096	.047	.013	.092	.046	.013	.088	.045	.013		
10.0	.097	.047	.013	.095	.046	.013	.092	.045	.013	.088	.044	.012	.085	.043	.012		

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.198	.198	.198	.169	.169	.169	.115	.115	.115	.066	.066	.066	.021	.021	.021	
1.0	.178	.165	.153	.152	.141	.132	.104	.097	.091	.060	.056	.053	.019	.018	.017	
2.0	.161	.140	.122	.138	.120	.105	.095	.083	.074	.055	.048	.043	.018	.016	.014	
3.0	.148	.121	.099	.127	.104	.086	.087	.072	.060	.050	.042	.036	.016	.014	.012	
4.0	.136	.106	.083	.117	.091	.072	.080	.064	.051	.047	.037	.030	.015	.012	.010	
5.0	.126	.094	.070	.109	.081	.061	.075	.057	.043	.043	.033	.025	.014	.011	.008	
6.0	.118	.084	.060	.101	.073	.052	.070	.051	.037	.041	.030	.022	.013	.010	.007	
7.0	.111	.076	.052	.095	.066	.046	.066	.046	.032	.038	.027	.019	.012	.009	.006	
8.0	.104	.070	.046	.090	.061	.040	.062	.043	.029	.036	.025	.017	.012	.008	.006	
9.0	.099	.064	.041	.085	.056	.036	.059	.039	.026	.034	.023	.015	.011	.008	.005	
10.0	.093	.060	.037	.081	.052	.032	.056	.036	.023	.033	.022	.014	.011	.007	.005	

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:邓光文
Test Date:2026-08-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity:65.0%
Test Distance:8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

UGR(Unified Glare Rating) Table

Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm										
NAME: LED洗墙灯					TYPE: /			WEIGHT: /		
SPEC.: 1000*43*91MM					DIM.: /			SERIAL No.: /		
MFR.: GZAILITELED					SUR.: 0.072			Shielding Angle: /		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	12.0	12.8	12.3	13.0	13.2	7.6	8.4	7.9	8.6	8.8
3H	12.9	13.6	13.2	13.8	14.0	8.1	8.8	8.3	9.0	9.2
4H	13.2	13.9	13.5	14.1	14.4	8.2	8.9	8.5	9.1	9.4
6H	13.4	14.0	13.7	14.3	14.6	8.4	9.0	8.7	9.3	9.5
8H	13.4	14.0	13.7	14.3	14.6	8.4	9.1	8.7	9.3	9.6
12H	13.4	14.0	13.7	14.3	14.6	8.5	9.1	8.8	9.4	9.7
4H 2H	12.0	12.7	12.3	12.9	13.2	8.1	8.8	8.4	9.0	9.2
3H	12.9	13.6	13.3	13.8	14.1	8.6	9.2	8.9	9.5	9.8
4H	13.3	13.9	13.7	14.2	14.5	8.9	9.4	9.2	9.7	10.1
6H	13.6	14.1	14.0	14.4	14.8	9.1	9.6	9.5	9.9	10.3
8H	13.6	14.1	14.1	14.5	14.9	9.2	9.6	9.6	10.0	10.4
12H	13.6	14.1	14.1	14.5	14.9	9.3	9.7	9.7	10.1	10.5
8H 4H	13.3	13.7	13.7	14.1	14.5	9.0	9.5	9.4	9.9	10.2
6H	13.6	14.0	14.0	14.4	14.8	9.3	9.7	9.8	10.1	10.6
8H	13.7	14.0	14.1	14.4	14.9	9.5	9.8	10.0	10.3	10.7
12H	13.7	14.0	14.2	14.4	14.9	9.7	10.0	10.2	10.4	10.9
12H 4H	13.2	13.6	13.6	14.0	14.4	9.0	9.4	9.4	9.8	10.2
6H	13.5	13.9	14.0	14.3	14.8	9.4	9.7	9.8	10.1	10.6
8H	13.6	13.9	14.1	14.4	14.9	9.6	9.8	10.0	10.3	10.8
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.6 / - 0.6					+ 0.9 / - 1.1				
1.5H	+ 1.0 / - 1.3					+ 1.0 / - 0.9				
2.0H	+ 2.2 / - 2.3					+ 1.3 / - 1.1				

CIE Pub.117, 1874 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 2.2$)
Area: 0.072 m²

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:邓光文
Test Date:2026-08-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity:65.0%
Test Distance:8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

UTILIZATION FACTORS TABLE

Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm		
NAME: LED洗墙灯	TYPE: /	WEIGHT: /
SPEC.: 1000*43*91MM	DIM.: /	SERIAL No.: /
MFR.: GZAILITELED	SUR.: 0.072	Shielding Angle: /


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	84	77	73	83	77	73	82	76	73	69
0.80	92	85	81	91	85	81	90	84	80	76
1.00	96	90	86	96	90	86	94	90	85	81
1.25	101	95	91	100	94	91	98	93	90	85
1.50	104	98	95	102	98	94	100	96	93	88
2.00	107	102	99	105	101	98	102	99	96	91
2.50	109	105	101	107	103	100	104	101	98	92
3.00	111	107	104	109	105	103	105	102	100	93
4.00	113	110	107	111	108	106	107	105	103	95
5.00	114	112	110	112	110	108	108	106	105	97
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: 邓光文
Test Date: 2026-08-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity: 65.0%
Test Distance: 8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

ISOCANDELA DIAGRAM

Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm		
NAME: LED洗墙灯	TYPE: /	WEIGHT: /
SPEC.: 1000*43*91MM	DIM.: /	SERIAL No.: /
MFR.: GZAILITELED	SUR.: 0.072	Shielding Angle: /

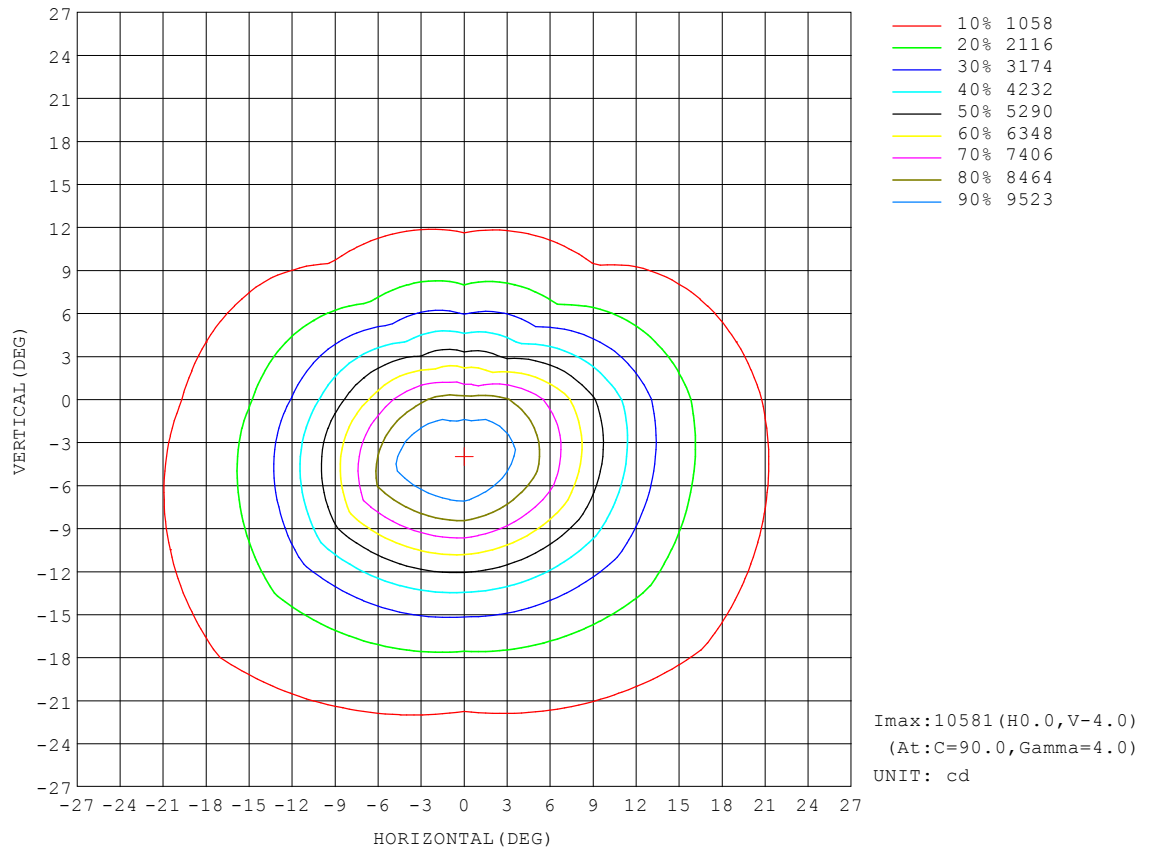


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:邓光文
Test Date:2026-08-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity:65.0%
Test Distance:8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

AAI Figure

Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm		
NAME: LED洗墙灯	TYPE: /	WEIGHT: /
SPEC.: 1000*43*91MM	DIM.: /	SERIAL No.: /
MFR.: GZAILITELED	SUR.: 0.072	Shielding Angle: /

Flux out:427.9 lm

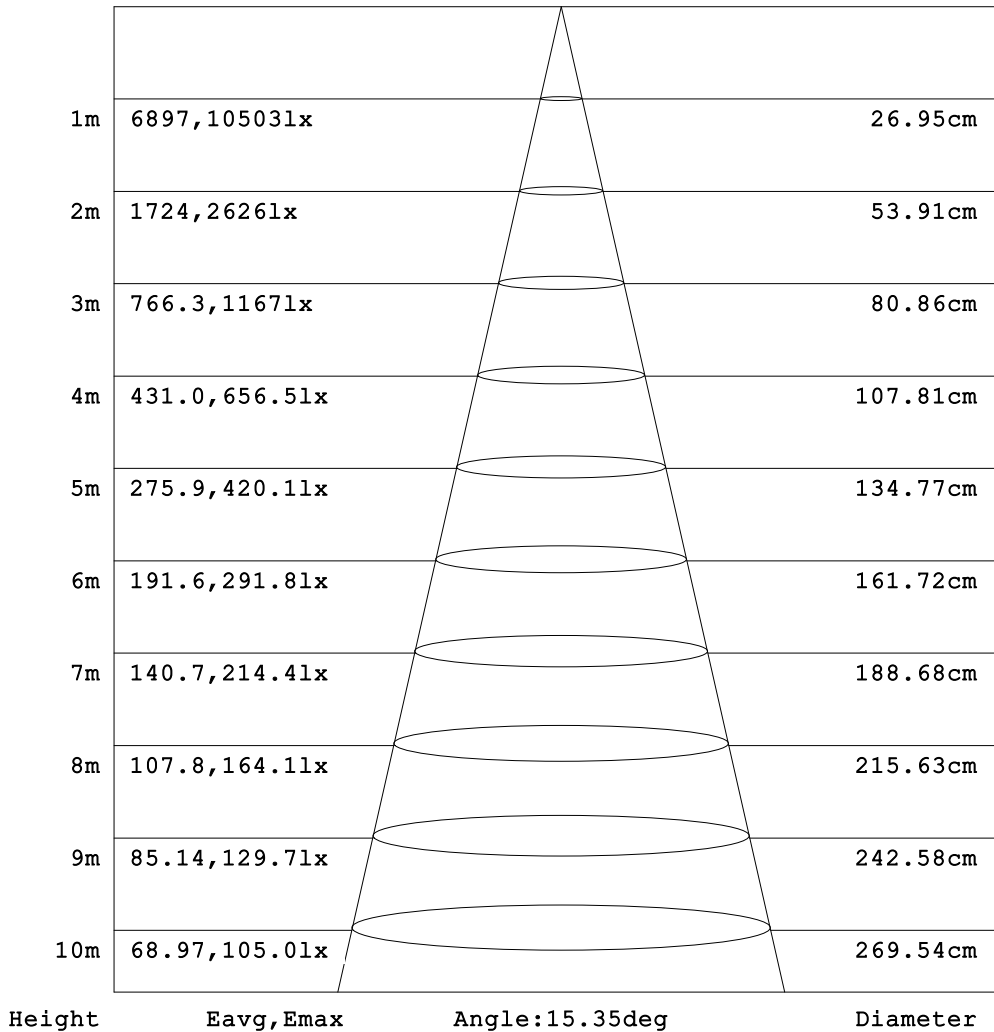


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:邓光文
Test Date:2026-08-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity:65.0%
Test Distance:8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

ISOLUX DIAGRAM

Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm		
NAME: LED洗墙灯	TYPE: /	WEIGHT: /
SPEC.: 1000*43*91MM	DIM.: /	SERIAL No.: /
MFR.: GZAILITELED	SUR.: 0.072	Shielding Angle: /

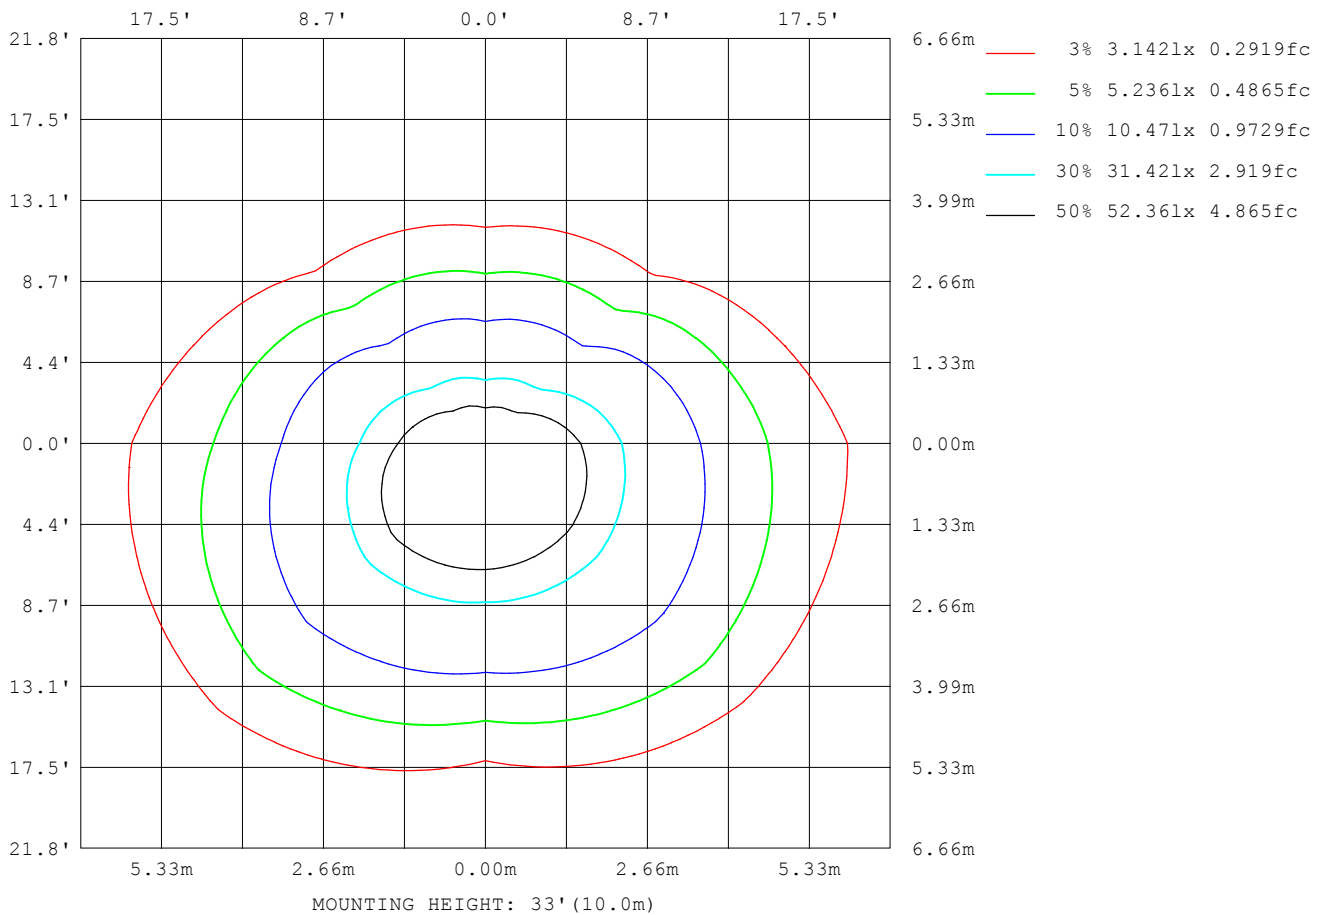

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: 邓光文
Test Date: 2026-08-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity: 65.0%
Test Distance: 8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

LED Avg.L Report

Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm		
NAME: LED洗墙灯	TYPE: /	WEIGHT: /
SPEC.: 1000*43*91MM	DIM.: /	SERIAL No.: /
MFR.: GZAILITELED	SUR.: 0.072	Shielding Angle: /


AvgL	cd/m2
L_0~180 (65) av	2913
L_0~180 (75) av	1899
L_0~180 (85) av	614
L_90~270 (65) av	453
L_90~270 (75) av	346
L_90~270 (85) av	461
L_45 (65) av	584
L_45 (75) av	438
L_45 (85) av	382

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:邓光文
Test Date:2026-08-29

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity:65.0%
Test Distance:8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

Planar Illuminance Curve

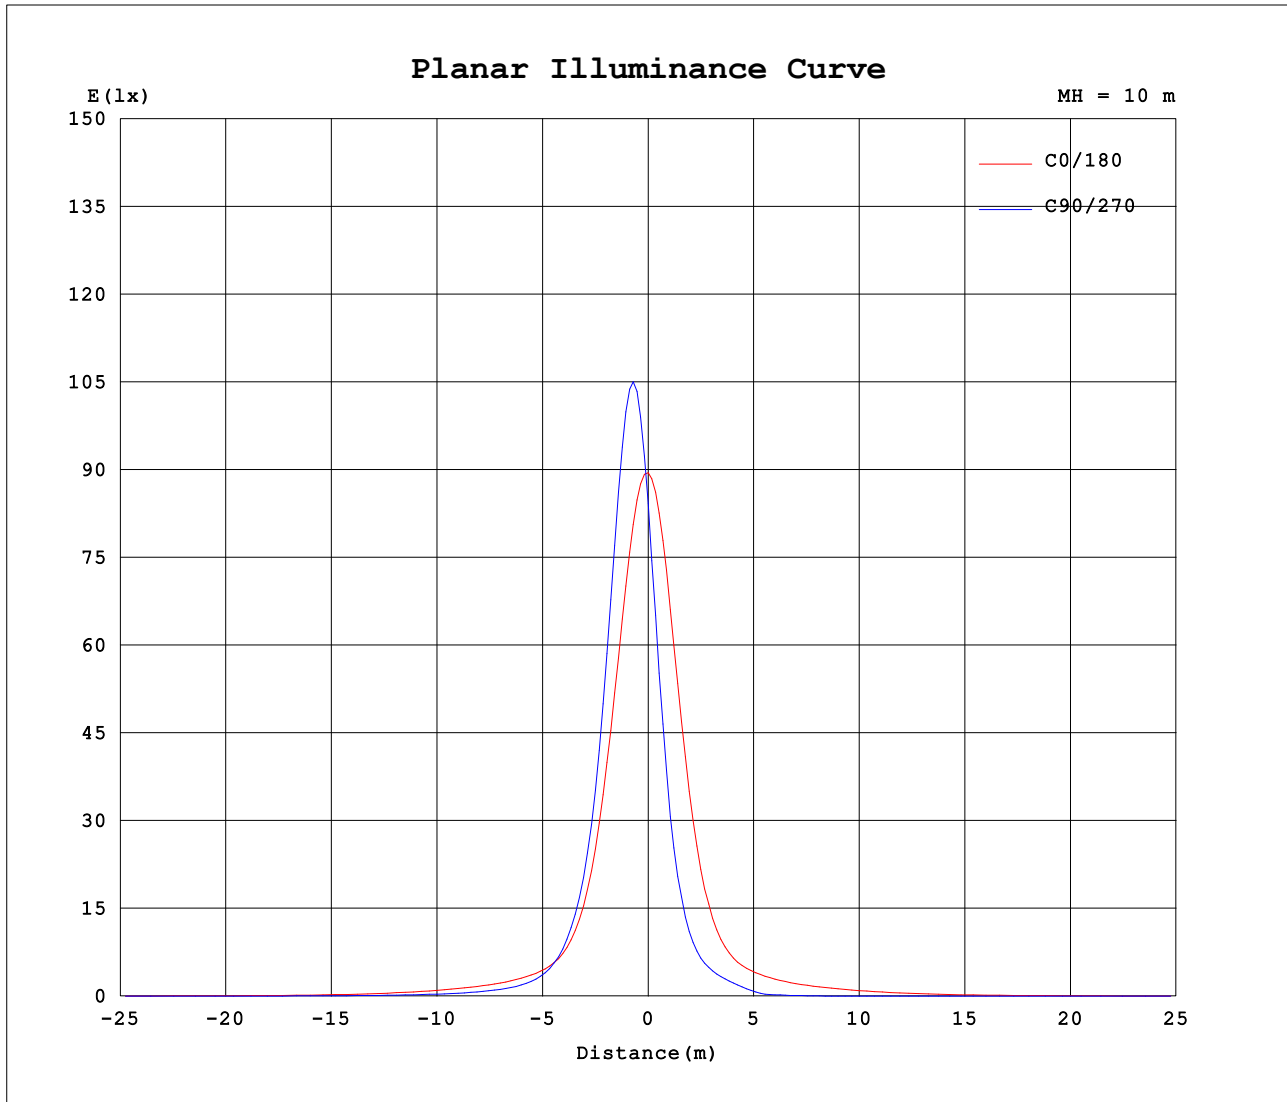

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: 邓光文
Test Date: 2026-08-29

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity: 65.0%
Test Distance: 8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:219.60V I:0.1160A P:24.100W PF:0.9430 Freq:49.99Hz Lamp Flux:1873.63x1 lm		
NAME: LED洗墙灯	TYPE: /	WEIGHT: /
SPEC.: 1000*43*91MM	DIM.: /	SERIAL No.: /
MFR.: GZAILITELED	SUR.: 0.072	Shielding Angle: /

Table--1


UNIT: ×10cd

C (DEG) γ (DEG)	0	45	90	135	180	225	270	315										
0	895	857	842	835	895	857	842	835										
5	768	956	1050	1009	737	473	391	455										
10	476	643	710	737	429	190	142	184										
15	239	330	326	369	204	81.4	62.7	79.3										
20	116	171	141	184	102	45.8	35.7	43.7										
25	69.6	92.9	63.8	101	64.4	29.6	17.4	28.4										
30	51.4	55.1	33.9	60.9	49.0	18.8	4.69	17.3										
35	41.4	34.6	21.4	38.3	39.6	9.93	2.53	7.07										
40	34.7	22.2	14.8	25.2	33.1	4.27	0.91	2.81										
45	28.6	14.7	10.8	16.6	27.5	1.92	0.35	1.22										
50	22.7	10.0	7.65	10.9	21.5	0.71	0.15	0.39										
55	17.2	6.91	5.32	7.28	15.9	0.22	0.05	0.19										
60	12.9	4.84	3.84	5.01	12.0	0.09	0.03	0.08										
65	9.25	3.50	2.73	3.55	8.48	0.03	0.03	0.03										
70	5.82	2.50	1.89	2.49	5.33	0.03	0.03	0.03										
75	3.71	1.62	1.26	1.60	3.37	0.03	0.03	0.03										
80	1.88	0.92	0.91	0.87	1.58	0.03	0.02	0.03										
85	0.49	0.49	0.57	0.42	0.28	0.02	0.01	0.02										
90	0.02	0.17	0.29	0.16	0.02	0.02	0.01	0.02										
95	0.03	0.10	0.23	0.10	0.03	0.02	0.01	0.02										
100	0.04	0.06	0.18	0.06	0.04	0.02	0.02	0.03										
105	0.05	0.04	0.12	0.04	0.06	0.03	0.03	0.04										
110	0.07	0.03	0.07	0.02	0.08	0.04	0.04	0.06										
115	0.10	0.03	0.04	0.02	0.10	0.06	0.05	0.09										
120	0.13	0.04	0.02	0.02	0.14	0.09	0.06	0.12										
125	0.17	0.06	0.02	0.03	0.18	0.13	0.09	0.18										
130	0.23	0.09	0.03	0.05	0.26	0.19	0.13	0.26										
135	0.34	0.14	0.05	0.07	0.37	0.29	0.22	0.40										
140	0.48	0.24	0.09	0.13	0.52	0.48	0.40	0.60										
145	0.66	0.41	0.16	0.23	0.69	0.73	0.70	0.82										
150	0.84	0.64	0.33	0.40	0.88	1.00	1.07	1.03										
155	1.02	0.90	0.63	0.65	1.06	1.22	1.34	1.19										
160	1.17	1.14	0.98	0.93	1.21	1.35	1.47	1.29										
165	1.30	1.34	1.26	1.16	1.34	1.35	1.50	1.32										
170	1.40	1.48	1.44	1.27	1.44	1.32	1.43	1.29										
175	1.49	1.53	1.50	1.28	1.51	1.39	1.36	1.28										
180	1.53	1.49	1.43	1.29	1.54	1.49	1.43	1.29										

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:邓光文
Test Date:2026-08-29


γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.443
Humidity:65.0%
Test Distance:8.440m [K=1.0000]
Remarks: 广州市花都区花城街永昌路21号
联系电话: 020-06933476

I (cd)

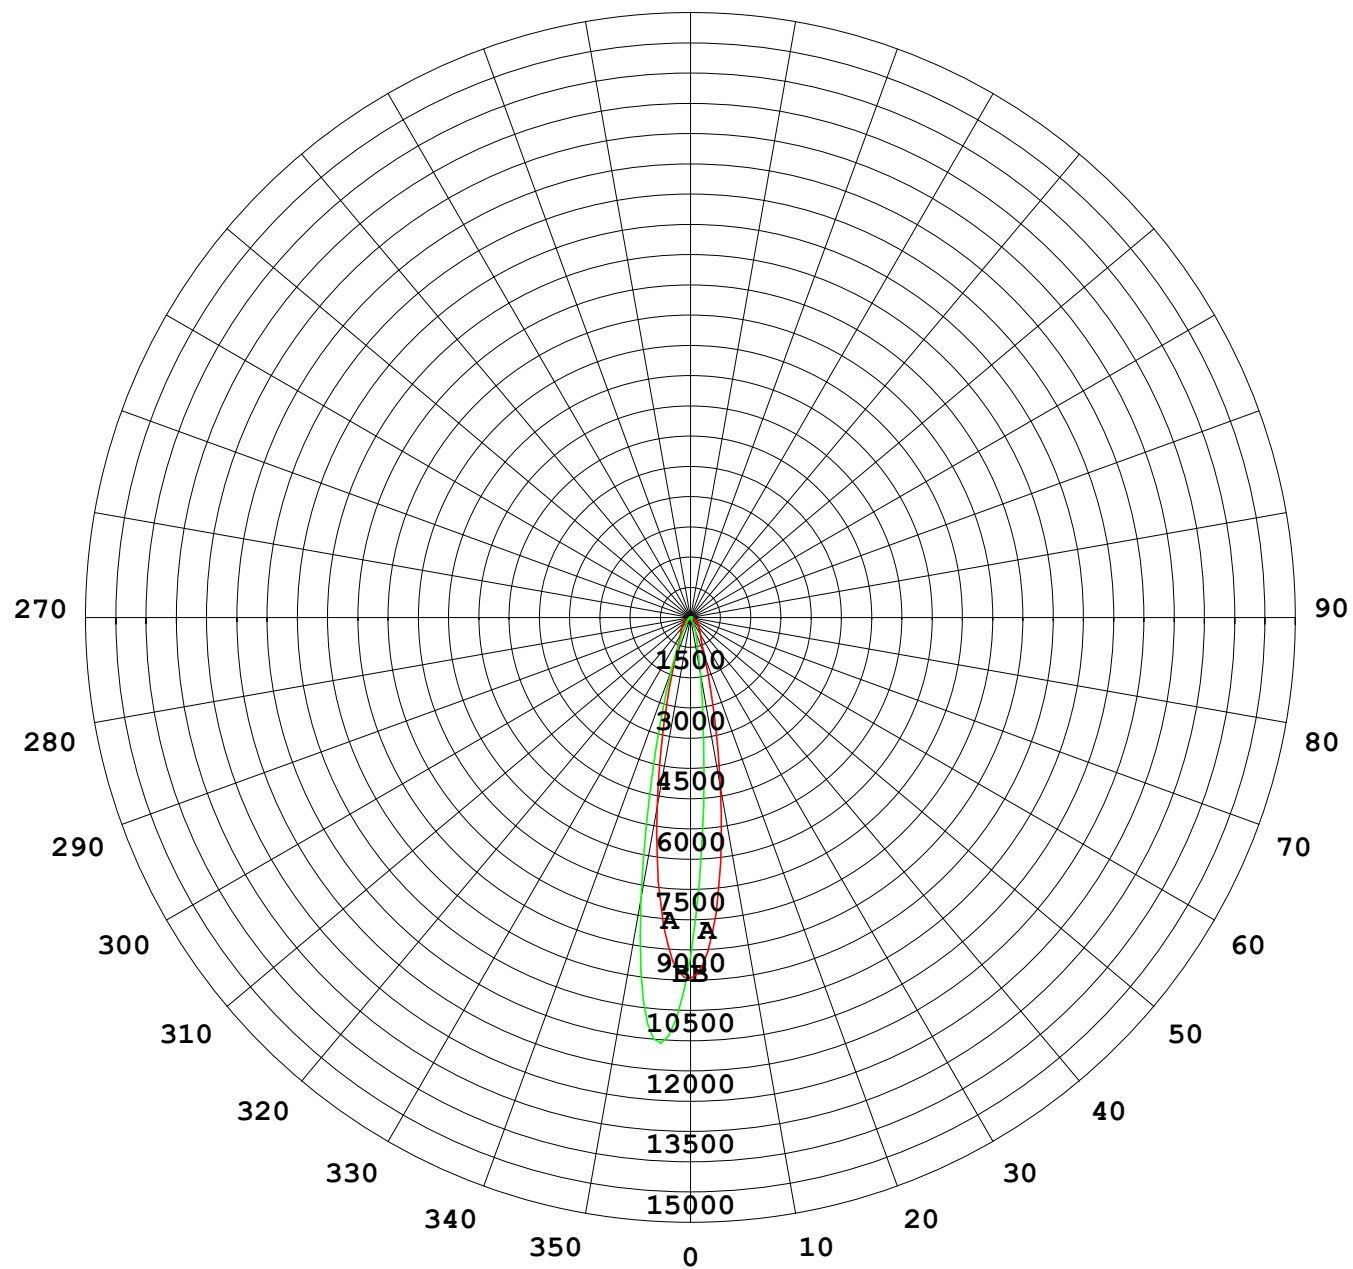

1000 lm

$\kappa = 1$

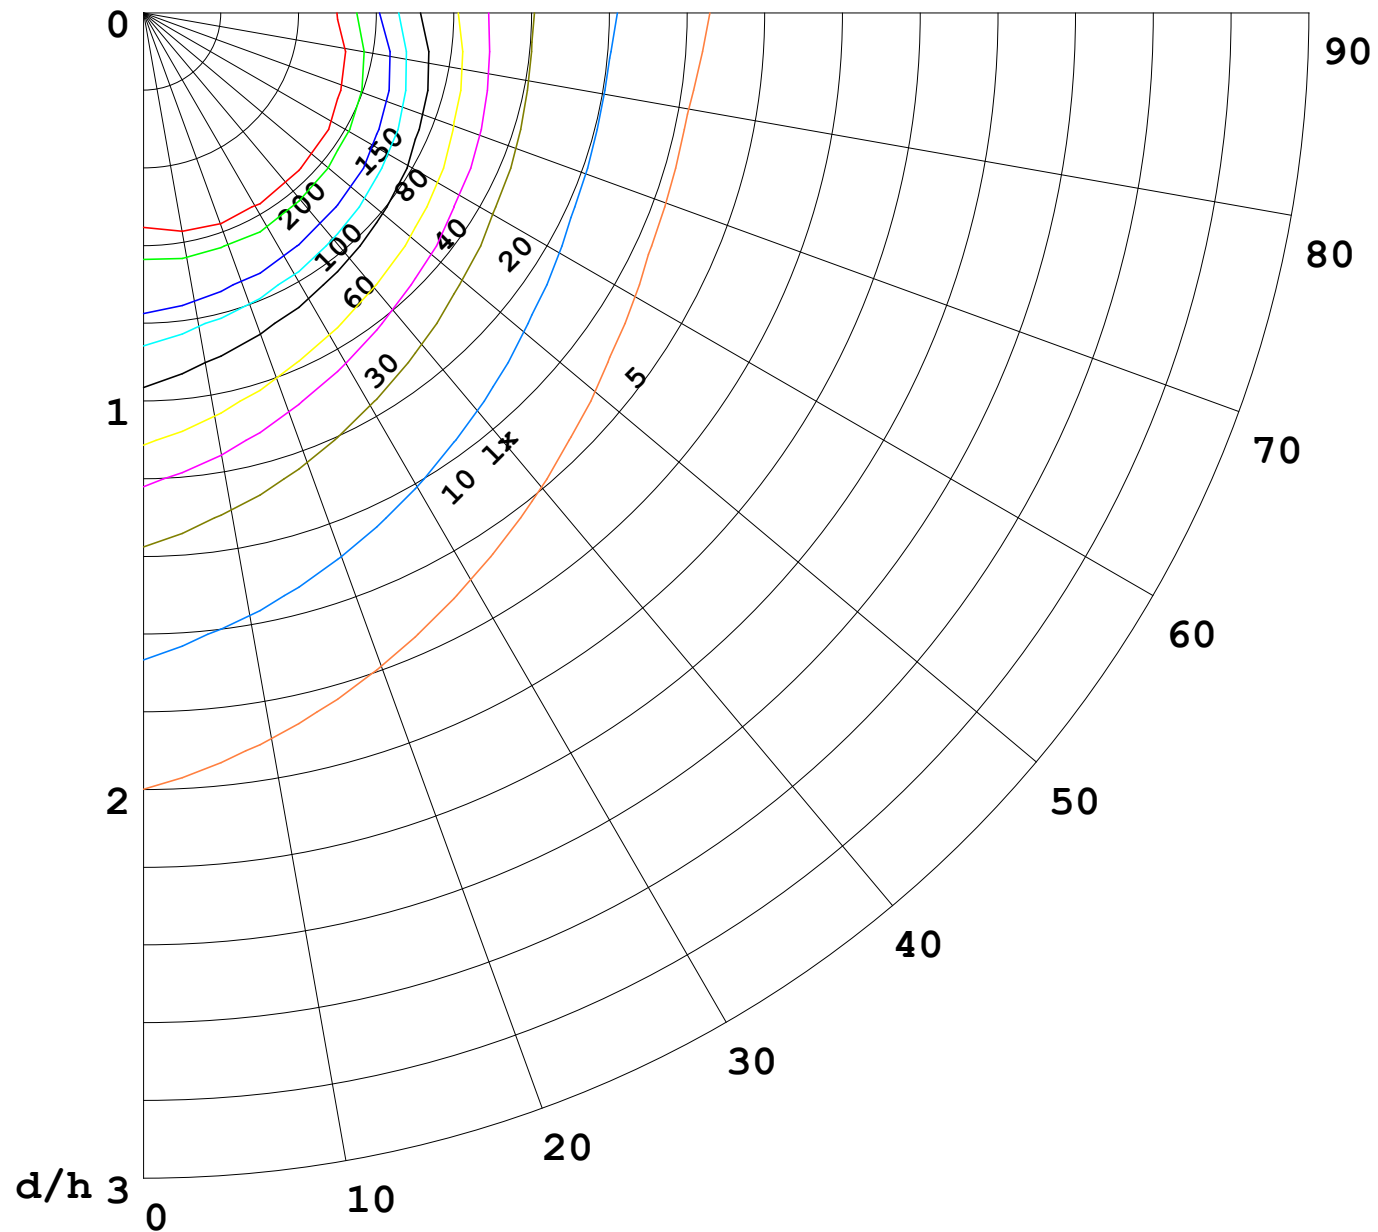

F = 5000 lm
 K = 0.7
 Hcc = 0.0 m
 Hfc = 0.0 m
 Eave = 100 lx

	Pcc	Pw	Pfc
—	70	50	30
—	50	30	20

